



# SM/H - VALVE ACTUATOR STEPPER MOTOR INSTRUCTION MANUAL 5019

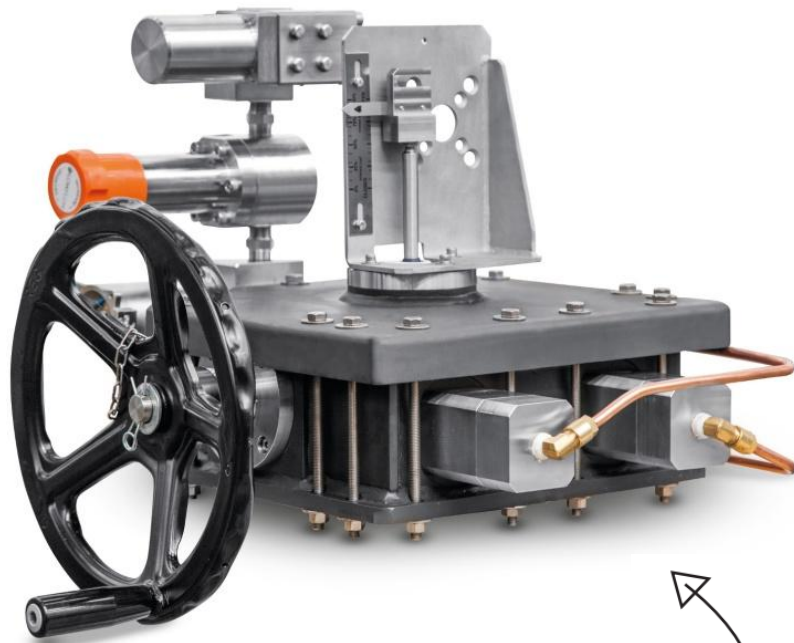

  
*Engineering  
GREAT Solutions*

*STI S.r.l. has taken every care in collecting and verifying the documentation contained in this Instruction Manual. The information herein contained are reserved property of STI S.r.l.*

## INDEX

<b>1</b>	<b>GENERAL INFORMATIONS</b> .....	<b>4</b>
1.1	GENERALITIES .....	4
1.2	MANUFACTURER.....	4
1.3	TERMS AND CONDITIONS .....	4
1.4	MANUFACTURER’S LIABILITY .....	4
1.5	APPLICABLE STANDARDS AND DIRECTIVES .....	5
1.6	SYMBOLGY USED.....	5
<b>2</b>	<b>DEVICE DESCRIPTION</b> .....	<b>6</b>
<b>3</b>	<b>TECHNICAL DATA</b> .....	<b>7</b>
<b>4</b>	<b>LABEL</b> .....	<b>8</b>
<b>5</b>	<b>OPERATING CONDITIONS AND INTENDED USE</b> .....	<b>9</b>
5.1	OPERATING CONDITIONS .....	9
5.2	INTENDED USE .....	9
<b>6</b>	<b>TRANSPORT</b> .....	<b>10</b>
<b>7</b>	<b>RECEPTION</b> .....	<b>10</b>
<b>8</b>	<b>STORAGE</b> .....	<b>10</b>
<b>9</b>	<b>INSTALLATION</b> .....	<b>11</b>
9.1	CHECKS TO BE PERFORMED BEFORE INSTALLATION .....	11
9.2	SM/H VALVE ACTUATOR INSTALLATION .....	11
9.3	HYDRAULIC CONNECTIONS .....	17
9.4	EARTHING CONNECTION.....	17
<b>10</b>	<b>INSTRUCTION FOR THE OPERATORS</b> .....	<b>18</b>
10.1	FIELD ACTIVITIES .....	18
10.2	RESIDUAL RISKS .....	18
<b>11</b>	<b>MAINTENANCE</b> .....	<b>19</b>
11.1	PERIODIC INSPECTIONS AND MAINTENANCE.....	19
11.2	EXTRAORDINARY MAINTENANCE .....	19
11.3	GREASES .....	20
<b>12</b>	<b>PARTS LIST GENERAL ASSEMBLY</b> .....	<b>21</b>
<b>13</b>	<b>TROUBLESHOOTING</b> .....	<b>24</b>
<b>14</b>	<b>SPARE PARTS</b> .....	<b>24</b>
<b>15</b>	<b>DISASSEMBLING</b> .....	<b>24</b>
<b>16</b>	<b>DECOMMISSIONING</b> .....	<b>25</b>



# 1 GENERAL INFORMATIONS

<b>Important</b>	<b>This Instruction Manual is an integral part of the machine, it should be carefully read before carrying out any operation and it should be kept for future references. The operators shall adopt the safety precautions required by the country where the product is installed.</b> <b>This Instruction Manual is realized in accordance with the Directive 2006/42/CE.</b>
------------------	---



## 1.1 Generalities

STI S.r.l. actuators are conceived, manufactured and controlled according to the Quality management System in compliance with EN ISO 9001 International Standard.

## 1.2 Manufacturer

With respect to Machinery Directive 2006/42/EC, the Manufacturer of the described SM/H valve actuator is STI S.r.l. as specified on the label.

STI S.r.l. Via Dei Caravaggi 15  
24040 Levate (BG) Italy  
Tel. +39 035 2928.2  
Fax +39 035 2928.247  
[imisti.sales@imi-critical.com](mailto:imisti.sales@imi-critical.com)

## 1.3 Terms and conditions

STI S.r.l. guarantees each single product to be free from defects and to conform to current goods specifications. The warranty period is two years from the date of shipment to the first user. The warranty does not cover special products or components not covered by warranty in their turn by subcontractors. No warranty is given for products which have been subject to improper storage, improper installation, improper maintenance or which have been modified or repaired by unauthorised personnel.

## 1.4 Manufacturer's liability

The SM/H valve actuator is designed in accordance with the applicable International Rules and Specifications, but the following regulations must be observed in any case:

- the general and safety regulations;
- the plant specific regulations and requirements;
- the proper use of personal devices, protective devices (glasses, clothing, gloves, etc), tools and transport equipment.

STI S.r.l. declines all liability in the event of:

- use SM/H valve actuator in other applications than the designated ones;
- use of the SM/H valve actuator in contravention of local safety at work legislation;
- lack of care during transport, installation, operations, maintenances of the SM/H valve actuator or incorrect application of the instructions provided on the SM/H valve actuator label and in this manual;
- modifications or repairs without STI S.r.l. authorisation;
- work done on the unit by unqualified or unsuitable operators.

Considering that STI S.r.l. has no direct control over particular applications, operation or maintenance conditions, it is the operator's responsibility to comply with all applicable safety rules; it is the sole responsibility of the operator to ensure that the local health and safety regulations are adhered to. Depending on the specific working conditions, additional precautions may be requested. Please inform STI S.r.l. urgently if you face unsafe situations not described in this Instruction Manual.

## 1.5 Applicable Standards and Directives

EN ISO 12100:2010	Safety of machinery - General principles for design - Risk assessment and risk reduction
IEC 61508:2010	Functional safety of electrical / electronic / programmable electronic safety-related systems
2006/42/EC	Machinery Directive
97/23/EC	Pressure Equipments Directive (PED)
94/9/CE	Equipments used in potentially explosive atmospheres (ATEX)

## 1.6 Symbology used

Dangerous symbols: be careful where these symbols are shown, they indicate a potentially hazardous situation and they warn that if the steps are not properly performed, may result causing serious injury, death or long-term risks to the health of exposed persons.



GENERAL DANGER



DANGER POWER SUPPLY



CRUSHING HAZARD

Obligation symbols: if these symbols are shown, the corresponding direction shall be followed.



General obligation  
(with the possible  
supplementary  
signboard)



Must wear  
protective  
clothing.



Must wear  
protective  
footwear.



Must wear  
protective  
helmet.



Must wear  
protective  
glasses



Must wear  
earplugs

## 2 DEVICE DESCRIPTION

The SM/H valve actuator is made by four main parts:

- the hydraulic circuit group, with two actuators able to make the steps and move the mechanism inside the box. One of the actuator moves the mechanism clockwise, the other one in counter-clockwise;
- the position transmitter group, located on the top of the actuator and directly connected to the valve stem;
- the manual override, located on the side of the SM/H actuator;

Different kind of hydraulic accessories could be mounting on the SM/H valve actuator depending on the performance required.

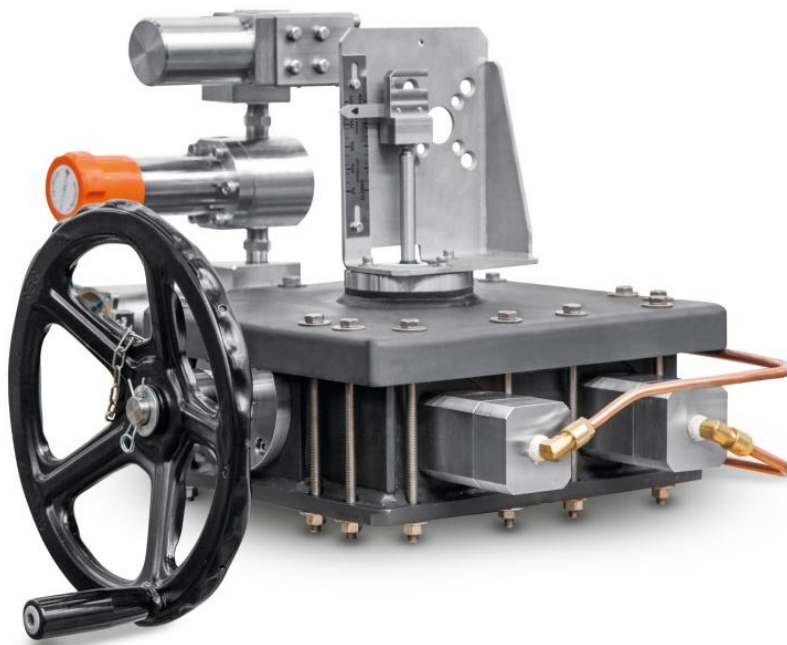


Figure 1 – SM/H valve actuator

### 3 TECHNICAL DATA

SM/H valve actuator	
<b>Model: SH01</b>	
Size (actuators diameter)	12mm
Max valve stroke (*)	70mm
Max operating torque	167Nm
Fluid (**)	Oil
Standard design pressure	207bar (3000psi)
Standard operating temperature range	-30°C/+50°C (-20°F/+120°F)
Time step SOV on/off (***)	See dimensional drawings
Expected lifetime	10 years

(\*) Depending on position system feedback;

(\*\*) Suitable in all the temperature range;

(\*\*\*) Greater than the ones reported in the dimensional drawing.



## 4 LABEL

Every SM/H valve actuator is provided with a label contains the main operating conditions and serial number. The label may change if the SM/H valve actuator is sold with reference to a Certificate of product and/or system issued by Notified Body Exterior or Certificate of Conformity issued by STI S.r.l..

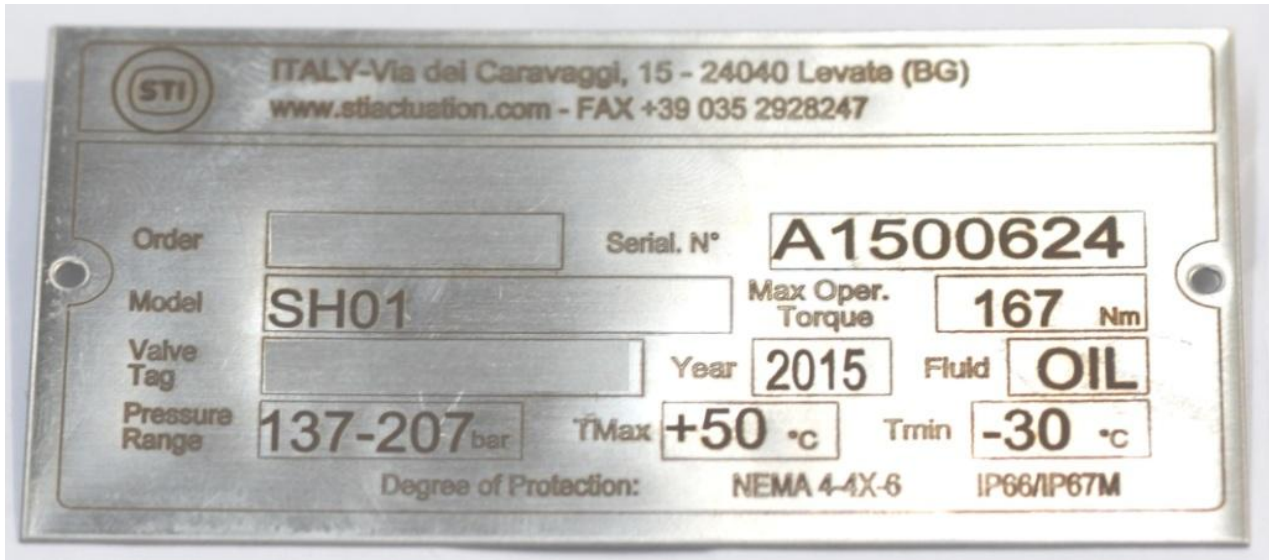





Figure 2 – SM/H standard label

<p><b>Warning</b></p> 	<p>It is severely forbidden to use the SM/H valve actuator under conditions other than those provided on the label.</p>
<p><b>Important</b></p> 	<p>It is forbidden to modify the information and the marks without previous written authorization by STI S.r.l.. Do not remove the label and/or replace with other label.</p>

## 5 OPERATING CONDITIONS AND INTENDED USE


<p><b>Warning</b></p> 	<p>It is severely forbidden to use the SM/H valve actuator for purpose or application other than those for which it was designed and here specified.</p>
---	--


### 5.1 Operating conditions


The label fastened on the SM/H valve actuator contains the main operating conditions for the specified application (see Section 4). Other operating conditions are reported on the documents accompanying the actuator. For general operating conditions see Section 3.

### 5.2 Intended use

The SM/H valve actuator series has been specifically designed in on-off application. In order to open/close the valve without the support of the supply fluid the manual override is required. The manual override handwheel is detachable in order to avoid injuries for the operators due the rotation of the mechanism located inside the stepper motor.


<p><b>Warning</b></p> 	<p>In order to use the manual override, remove the pressure inside the hydraulic circuit and then fix the detachable handwheel on the shaft using the screw linked to the handwheel by a chain. After the manual override using take off the screw from the shaft / handwheel and restore the pressure.</p>
---	---


<p><b>Important</b></p> 	<p>The handwheel is always secured on the shaft by a cotter pin. Be careful to any unexpected rotation of the handwheel during the running of the actuator. In order to avoid any handwheel rotation, remove the pressure inside the hydraulic circuit and then take off the copper pin, the washer and the handwheel from the shaft. At the end restore the pressure.</p>
---	--

<p><b>Important</b></p> 	<p>During the running of the actuator, the manual override shaft is always engaged.</p>
---	---

After the manual override using, check the correct behavior of the SM/H valve actuator with a functional test or a visual check.

## 6 TRANSPORT

<p><b>Warning</b></p> 	<p><b>The following instructions must be respected:</b></p> <ul style="list-style-type: none"><li>- operations must be carried out only by skilled operators;</li><li>- always wear protective clothing, gloves, and eyewear to prevent personal injury. Check with your process or safety engineer for any additional measures that must be taken to protect against process media.</li></ul>
---	--

<p><b>Important</b></p> 	<p><b>The lifting and handling should be made in compliance with the laws and provisions in force.</b></p>
---	--

Lift the SM/H valve actuator with belts, using its eyebolts. Make sure that the belts never scratches the accessories and hydraulic/electric connection.

## 7 RECEPTION

SM/H valve actuator leave the factory in perfect condition. Performances of each unit are guaranteed by tests and data reported on a specific Test Report. At the reception of the SM/H valve actuator:


- check that the model correspond with that of order confirmation;
- check that the hydraulic diagrams, wiring diagrams and dimensional drawing are furnished with document accompanying the actuator;
- check that the SM/H valve actuator was not damaged during transportation. If necessary renovate the painting according to the specification reported on the order confirmation.


## 8 STORAGE

In order to maintain the guaranteed actuator performances until the SM/H valve actuator is installed on site, proper attention must be observed for preservation during the storage period. If the SM/H valve actuator needs storage before installation:

- place it in a dry, clean place and take all necessary measures to avoid contact with dust, dirt and humidity during storage;
- make sure that connection protections and/or the mechanical locks will not be removed during the storage;
- storage temperature must be between -20°C and +40°C.

## 9 INSTALLATION

<p><b>Warning</b></p> 	<p>The following instructions must be respected:</p> <ul style="list-style-type: none"> <li>- operations must be carried out only by skilled operators;</li> <li>- always wear protective clothing, gloves, and eyewear to prevent personal injury. Check with your process or safety engineer for any additional measures that must be taken to protect against process media.</li> </ul>
---	--

<p><b>Important</b></p> 	<p>Not performing the following procedures will invalidate the product warranty.</p>
---	--



### 9.1 Checks to be performed before installation


It is recommended to check the SM/H valve actuator conditions before the installation, then:

- prepare the necessary tools for the assembly and setting of the unit;
- check that the coupling dimensions meet the specified coupling dimensions;
- clean the SM/H valve actuator surfaces and remove anything that might prevent a perfect adherence with the valve;


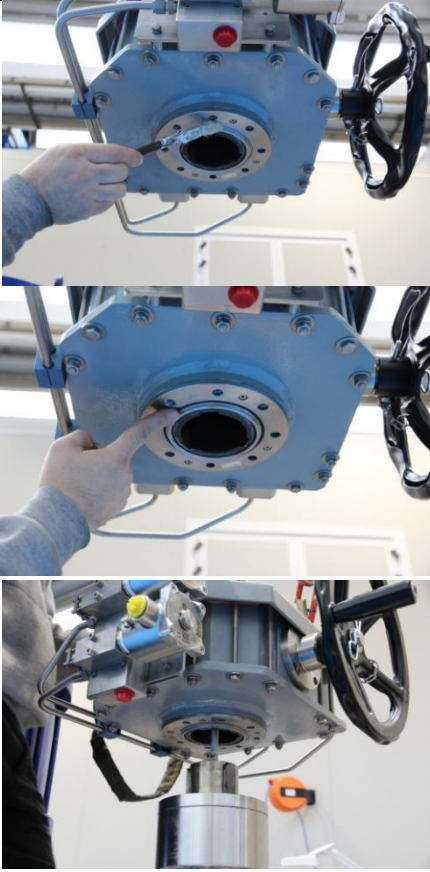
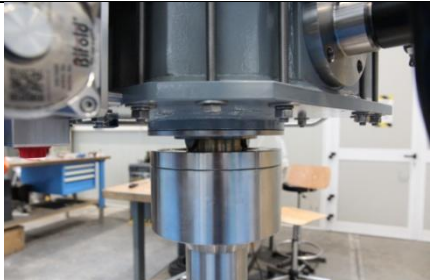
### 9.2 SM/H valve actuator installation


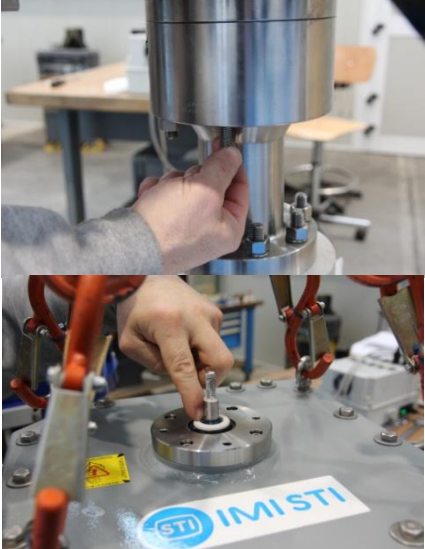
In order to perform a proper installation follow these steps.

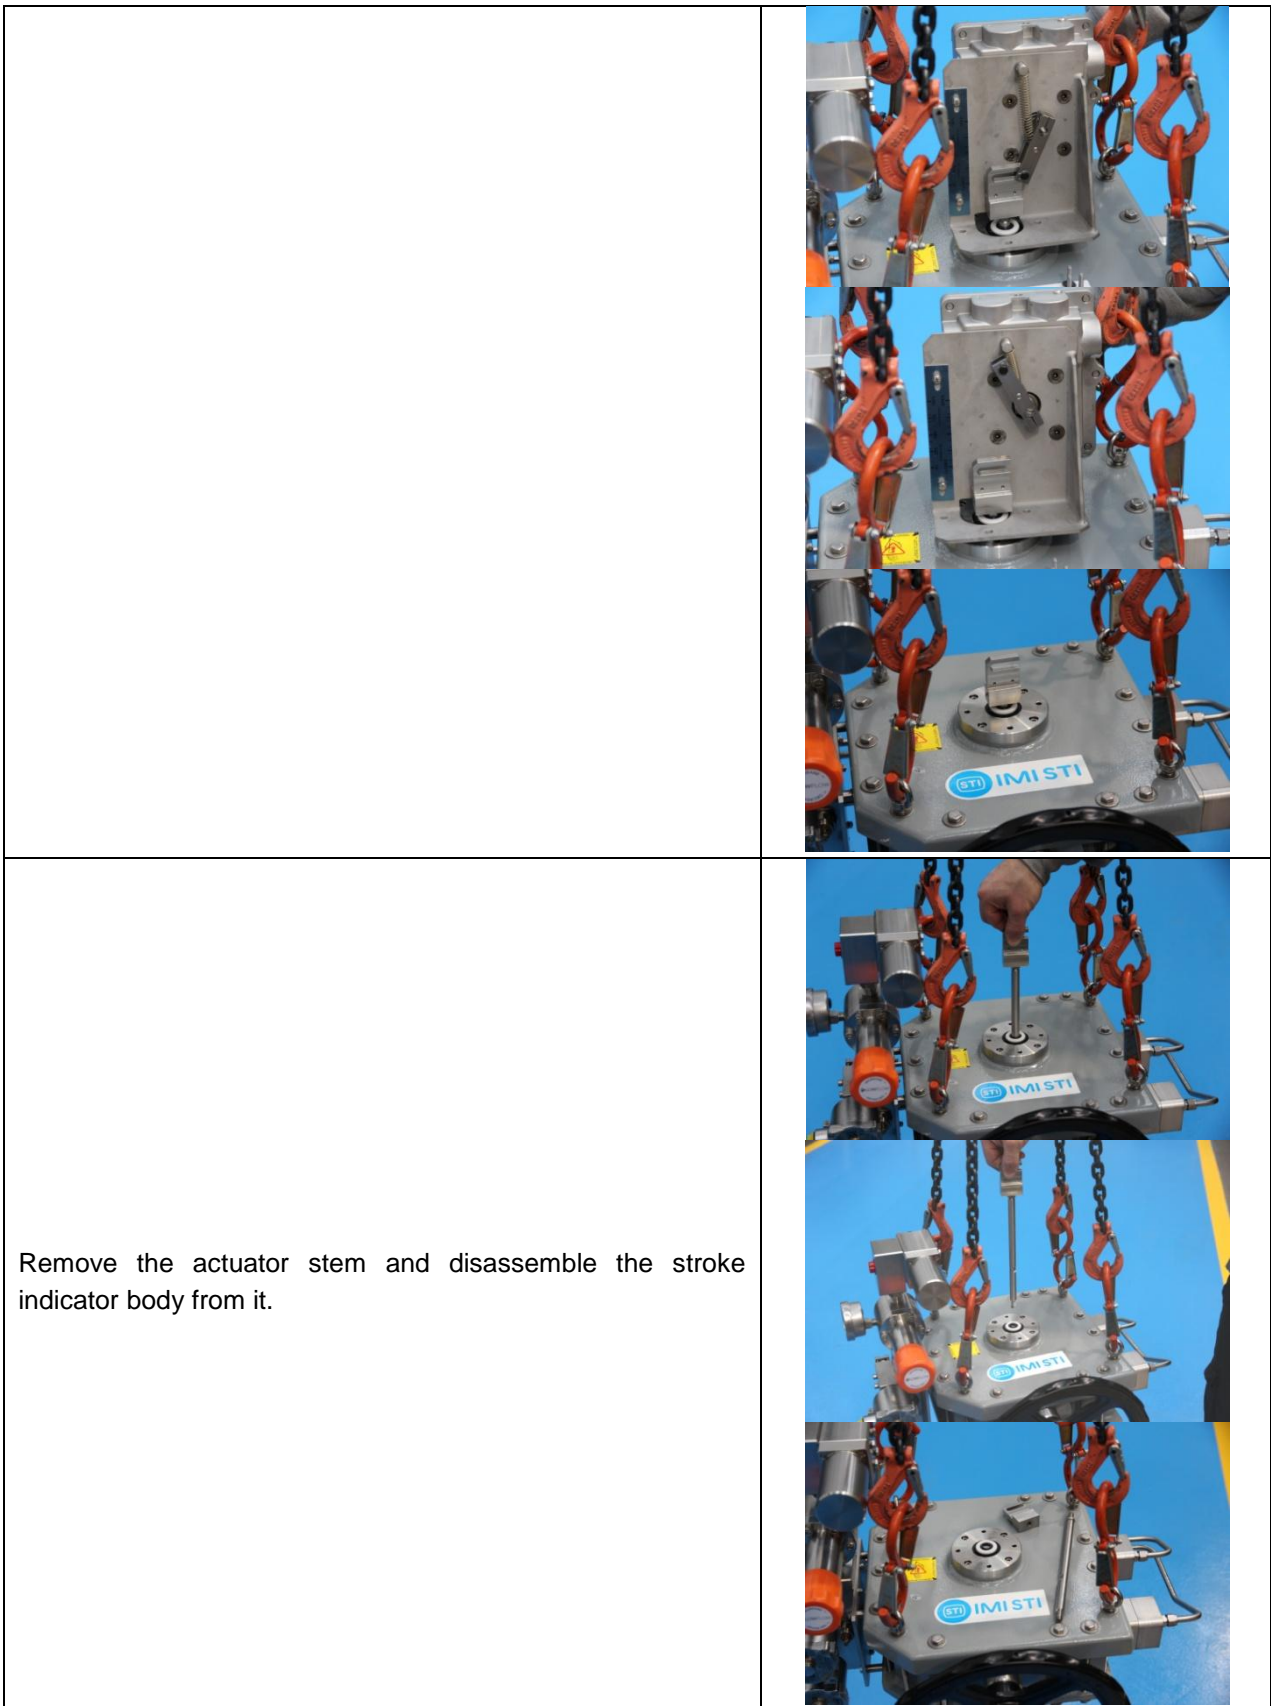

<p>Hold the SM/H valve actuator using the eyebolts.</p>	
<p>Unscrew the n°3 M5 screws and take off the position transmitter group.</p>	





<p>Tighten the actuator stem in the valve stem and put the n°3 feather keys on the rotation nut of the valve.</p>	
<p>Mount the O-ring properly greased on the lower flange of the SM/H valve actuator and put the SM/H valve actuator over the valve.</p>	
<p>Mount the SM/H valve actuator on the valve by letting in the feather keys in their seats (the feather key seats are obtained in the internal step mechanism of the actuator). The register is made by the lower flange of the actuator. During this step pay attention that the actuator stem enters properly the dust seal of the top flange.</p>	

	
<p>Tighten the yoke tie rods and then push the dust seal in its seat.</p>	

<p><b>Warning</b></p> 	<p><b>Do not lift the valve with the SM/H valve actuator eyebolts.</b></p>	 <p>NON SOLLEVARE LA VALVOLA CON I GOLFARI DELL'ATTUATORE</p> <p>NO LEVANTAR LA VALVULA CON ARMELLAS DEL ACTUADOR</p> <p>DO NOT LIFT THE VALVE WITH ACTUATOR EYEBOLTS</p> <p>不要使用执行器上的吊环起吊阀门</p>
---	--	--


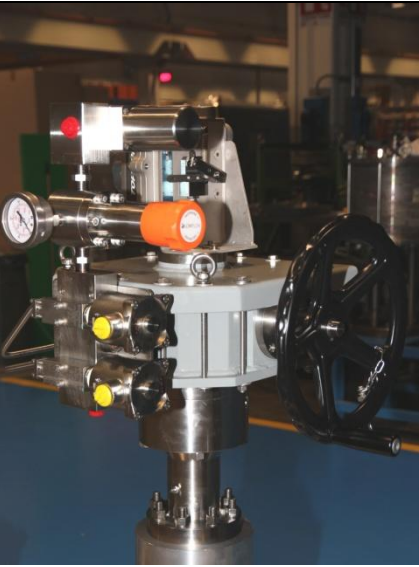
Mount the nut and the stroke indicator body, then tighten them.




Mount the transmitter position group and then the stroke indicator (using n°2 M3 screws).





	
<p>At the end try to open /close the valve using the manual override (see 5.2).</p>	


### 9.3 Hydraulic connections

<p><b>Warning</b></p> 	<p><b>Check that the values of hydraulic supply available are compatible with those reported on the label of the SM/H valve actuator.</b></p> <p><b>User must consider and take all precautions to avoid that pressurized parts are not used out of specified range and to avoid exposure to fire.</b></p>
---	--

It is required to follow this steps during the hydraulic connection:


- no lubricators on supply fluid line is required;
- use pipes and connections appropriate as for type, rating, material and dimensions;
- properly deburr the ends of rigid pipes;
- properly clean the interior of pipes sending through them plenty of the supply fluid;
- use pipe sealant sparingly and only on male threads. A non-hardening sealant is strongly recommended;
- fasten the connection pipes so that no irregular strains or loosening of threaded connections occur;
- check the absence of leakages from hydraulic connections. If necessary tighten the nuts of the pipe-fittings;
- after connecting the actuator, gradually increase the supply pressure up to the maximum operating pressure.


### 9.4 Earthing connection

<p><b>Warning</b></p> 	<p><b>Check if the SM/H valve actuator has a properly earthing connection.</b></p>
---	--

The earthing connection is guaranteed trough the fixing flange of the SM/H valve actuator. If the earthing connection of the system where SM/H valve actuator is mounted is not guaranteed, it is required to ensure a directly earthing connection.

## 10 INSTRUCTION FOR THE OPERATORS

<b>Warning</b> 	<p>The following instructions must be respected:</p> <ul style="list-style-type: none"> <li>- operations must be carried out only by skilled operators;</li> <li>- always wear protective clothing, gloves, and eyewear to prevent personal injury. Check with your process or safety engineer for any additional measures that must be taken to protect against process media.</li> </ul>
---	--

<b>Important</b> 	<p>Any repair work other than the operations outlines in this Instruction Manual is allowed only if STI S.r.l. authorises it.</p>
---	---

### 10.1 Field activities

During the start-up of the SM/H valve actuator:


- check that the pressure and quality of the supply fluid (filtering degree, dehydration, etcetera) are as prescribed;
- check if the operating condition are as prescribed;
- check that there are no leak of the hydraulic connections;
- check that there are no leak of the accessories mounted on the SM/H valve actuator;
- check that there are no leak of the hydraulic cylinder of SM/H valve actuator;
- for any detail about the accessory mounted on the SM/H valve actuator see their instruction manuals;
- remove all rust on the SM/H valve actuator surfaces;
- repair paint-coat that has been damaged, in accordance with the applicable painting specifications;
- perform a complete functional test.

### 10.2 Residual Risks

Reasonably foreseeable misuse:

- risk due to movements of loads during transport and installation;
- crushing during transport and installation;
- installation in ambient with not planned conditions;
- metal temperature at high or very low values as consequence of ambient temperature as to be considered as a risk of person injury in case of contact;
- insert incorrect motive fluid into the system;
- supply pressure out of planned range.

## 11 MAINTENANCE

<p><b>Warning</b></p> 	<p><b>The following instructions must be respected:</b></p> <ul style="list-style-type: none"><li>- operations must be carried out only by skilled operators (STI operators or operators qualified by STI are recommended);</li><li>- always wear protective clothing, gloves, and eyewear to prevent personal injury. Check with your process or safety engineer for any additional measures that must be taken to protect against process media.</li></ul>
---	--

Before any type of operation and/or maintenance is performed, make sure that:

- actuator, accessories and all connected equipment are not under pressure and in safe conditions;
- fluid supply, power or other energy sources and signals are disconnected.

### 11.1 Periodic Inspections and maintenance

Periodic visual inspections are recommended. The user shall:

- plan and provide for a periodic cleaning/maintenance program that will maintain the external surface of the SM/H valve actuator free from excessive layer of dust.

### 11.2 Extraordinary maintenance


In case of extraordinary maintenance, following malfunction and related troubleshooting, proceed as written in Section 13.

### 11.3 Greases

SM/H cylinder material	Very Low temperature (Tmin ≤ -40°C)	Low temperature (-40°C < Tmin < -20°C)	Standard temperature (-20°C ≤ T ≤ -70°C)	High temperature (Tmax > 70°C)
Aluminum	RHEOLUBE 361F (Tecnolube seal)	RHOESIL 500F (Tecnolube seal)	MOLYGUARD IDROSFER	SYNTHY 101 (Tecnolube seal)
Nickel plated carbon steel	RHEOLUBE 361F (Tecnolube seal)	RHOESIL 500F (Tecnolube seal)	MOLYGUARD IDROSFER	SYNTHY 101 (Tecnolube seal)
Chrome plated carbon steel	RHEOLUBE 361F (Tecnolube seal)	RHOESIL 500F (Tecnolube seal)	POLIMER 400/1 (Tecnolube seal)	SYNTHY 101 (Tecnolube seal)
Stainless steel	RHEOLUBE 361F (Tecnolube seal)	RHOESIL 500F (Tecnolube seal)	POLIMER 400/1 (Tecnolube seal)	SYNTHY 101 (Tecnolube seal)
Fiber	RHEOLUBE 361F (Tecnolube seal)	RHOESIL 500F (Tecnolube seal)	POLIMER 400/1 (Tecnolube seal)	SYNTHY 101 (Tecnolube seal)


Manual override material	Very Low temperature (Tmin ≤ -40°C)	Low temperature (-40°C < Tmin < -20°C)	Standard temperature	High temperature (Tmax > 70°C)
All material	MOLIKOTE	MU EP (Agip)	MU EP (Agip)	MU EP (Agip)

## 12 PARTS LIST GENERAL ASSEMBLY

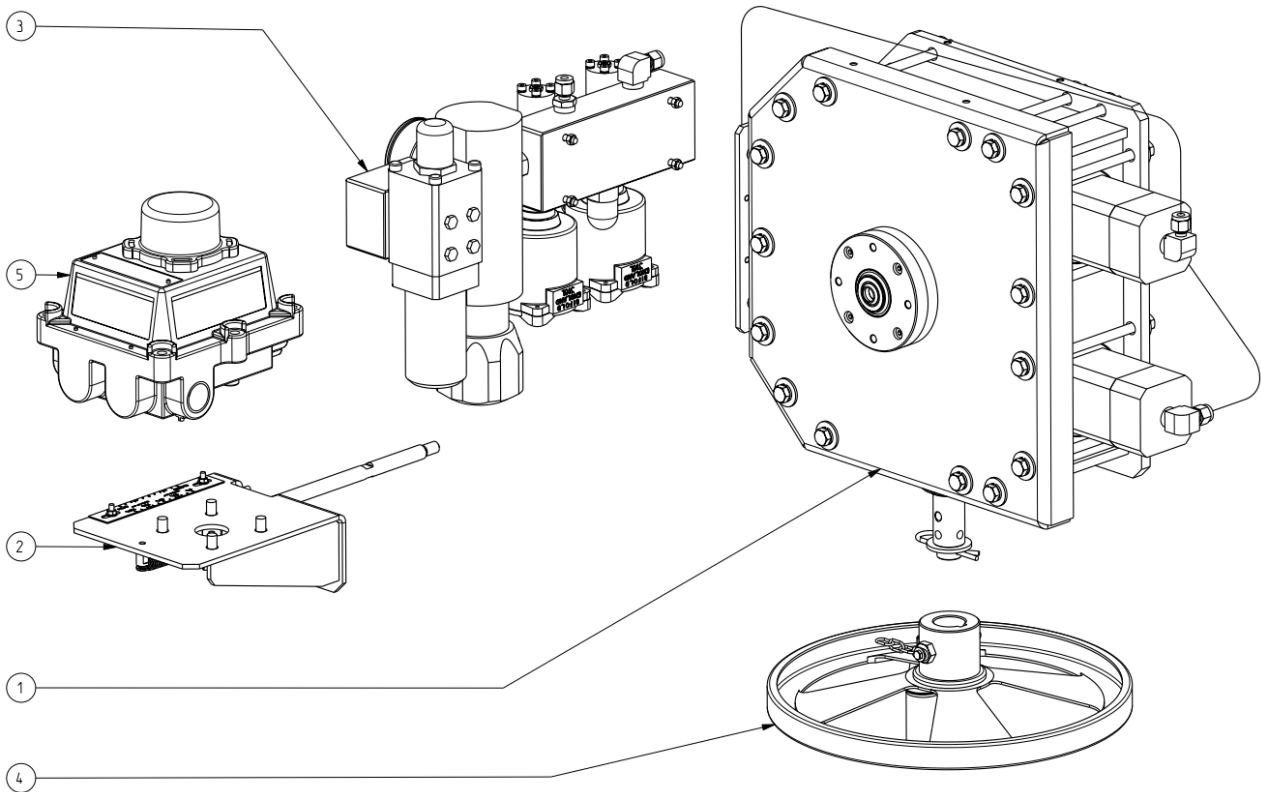

POS.	Q.TY'	DESCRIPTION
1	1	STEPPER
2	1	POSITION TRANSDUCER ASSEMBLY
3	1	MANIFOLD ASSEMBLY
4	1	SOLID TYPE HAND
5	1	POSITION TRANSMITTER

Figure 3 – SM/H valve actuator

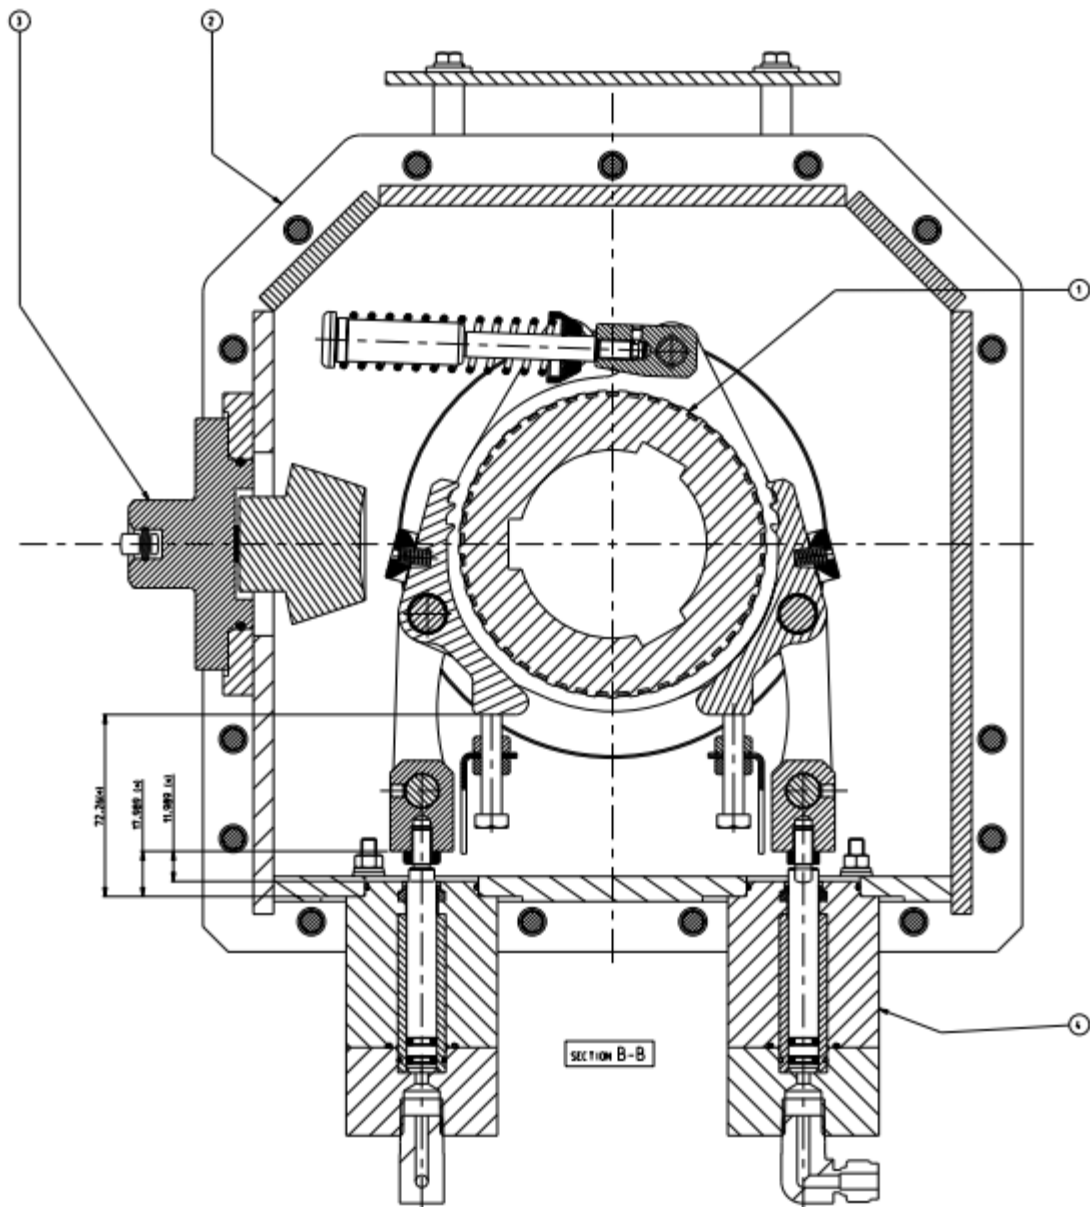

POS.	Q.TY	DESCRIPTION
1	1	MECHANISM ASSEMBLY
2	1	BOX ASSEMBLY
3	1	BEVEL GEAR ASSEMBLY
4	2	CYLINDER ASSEMBLY

Figure 4 – SM/H Box: step mechanism and hydraulic actuators

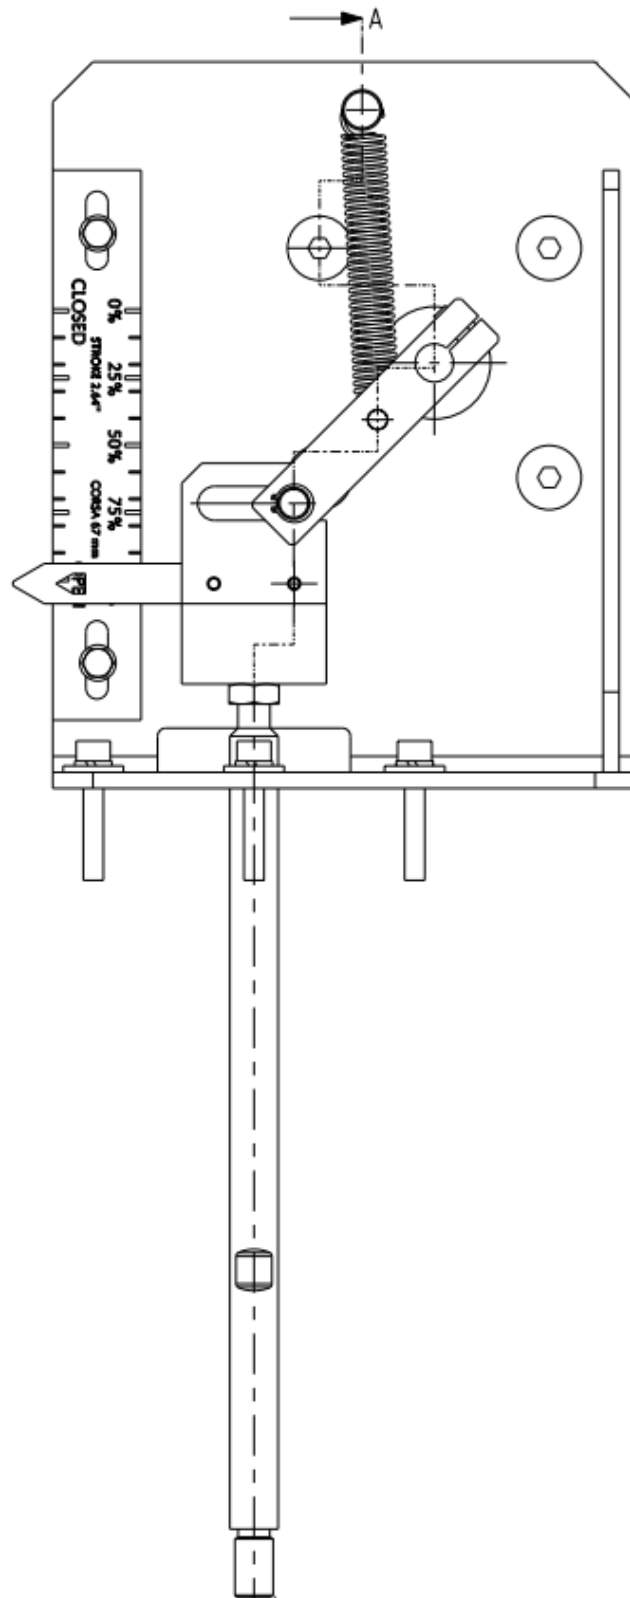



Figure 5 – Position transmitter group



## 13 TROUBLESHOOTING


EVENT	POSSIBLE CAUSE	REMEDY
SM/H valve actuator doesn't move	Lack of hydraulic supply	Check supply line
	Low supply pressure	Adjust supply pressure
	Hydraulic circuit failure	Call STI S.r.l.
	Torque not enough (valve seizing)	Call valve manufacturer
	Torque not enough (wrong actuator sizing)	Call STI S.r.l.
	Damaged actuator internal component	Call STI S.r.l.
Opening/Closing time not satisfy	Hydraulic circuit not suitable	Call STI S.r.l.
	Hydraulic fluid not suitable	Call STI S.r.l.
	Wrong actuator sizing	Call STI S.r.l.
Leakages from hydraulic cylinder	Deterioration and/or damage of gasket	Call STI S.r.l.
	Incorrect tighten of the hydraulic actuator tie rods	Call STI S.r.l.
Leakages from hydraulic circuit	The nuts of pipe fittings are not tighten enough	Tighten the nuts
	An accessory does not work correctly	Call STI S.r.l.

<b>Important</b> 	<p>If another event happens or another possible cause of the above events has been detected, call STI S.r.l.</p>
---	--


## 14 SPARE PARTS


Spare parts can be sent to the customer if required. Contact STI S.r.l.

## 15 DISASSEMBLING

<b>Important</b> 	<p>The disassembling of the main body (box with the hydraulics actuators and the step mechanism inside) is not allowed if it is not authorized by STI S.r.l.</p>
---	--

## 16 DECOMMISSIONING

<p><b>Warning</b></p> 	<p>The following instructions must be respected:</p> <ul style="list-style-type: none"> <li>- operations must be carried out only by skilled operators;</li> <li>- always wear protective clothing, gloves, and eyewear to prevent personal injury. Check with your process or safety engineer for any additional measures that must be taken to protect against process media.</li> </ul>
---	--

<p><b>Important</b></p> 	<p>Check local authority regulation before disposal.</p>
---	--

SUBJECT	HAZARDOUS	RECYCABLE	DISPOSAL
Metals	No	Yes	Use licensed recyclers
Plastics	No	Yes	Use specialist recyclers
Rubber (seals, o-rings)	Yes	No	May require special treatment before disposal, use specialist waste disposal companies
Oil and grease	Yes	Yes	May require special treatment before disposal, use specialist waste disposal companies